

Product Code

3133W/2

Check Valve

1/4"ODS

PS = 50 bar - 600 PSI



Product use

Accessories for use with the following ASHRAE 34:2019 refrigerants, Class A1, A2L, or A3:
HFC (R134A, R32, R404A, R407C, R410A, R507)
HFO (R1234YF, R1234ZE)
HFO + HFC (R448A, R449A, R450A, R452A, R452B, R454A, R454B, R454C, R455A, R513A, R515A, R515B)
HC (R290, R600, R600A, R1270)

Product details

Desenho 

N° catálogo 3133W/2

Conexões SAE Flare -

Conexões ODS Ø [in.] 1/4"



ODS Ø [mm] -

Kv [m³/h] 0,5

Pressão diferencial (2) [bar] 0,3

PS [bar] 50

MWP [psi] (1) 600

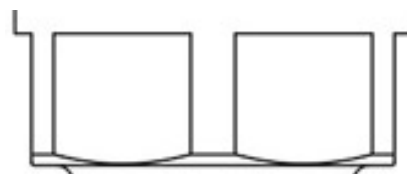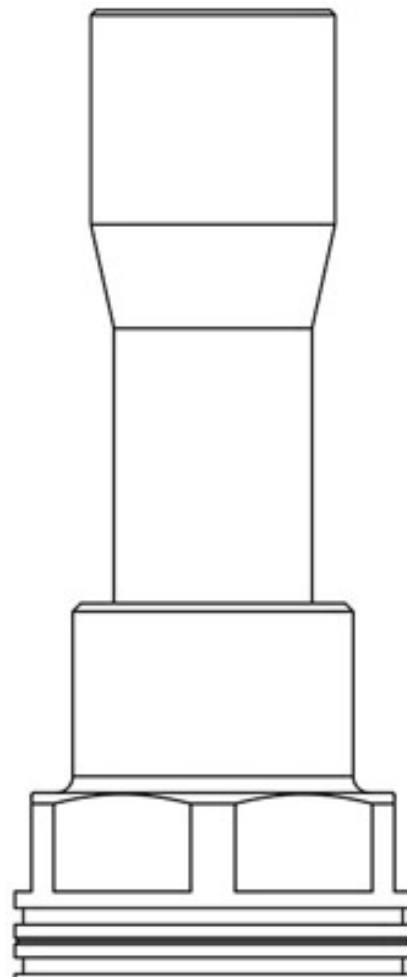

TS [°C] min.	-40
TS [°C] max.	+150
Embalagem	25

Notes

- (1): em conformidade com a aprovação UL
- (2): pressão mínima na qual a válvula está completamente aberta